



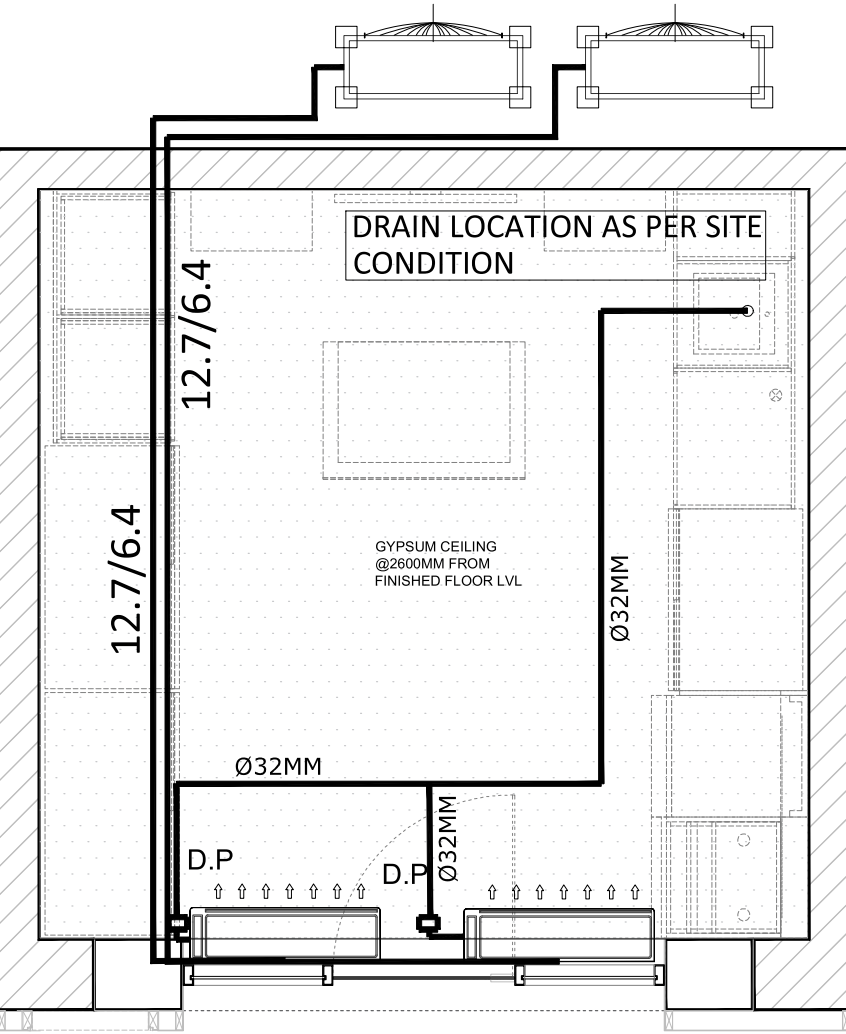

DX SIDE DISCHARGE ODU
CAPACITY: 1.5 TR x 2Nos
SIZE : 845Wx300Dx595H

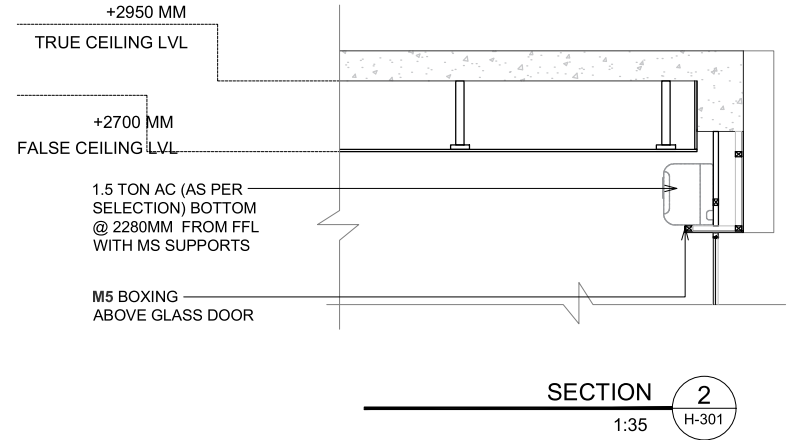

DX HIWALL UNIT = 2 Nos
CAPACITY: 1.5 TR
SIZE: 885W X 229D X 298H

HVAC LAYOUT 1:35 H-301

GENERAL NOTES - THIS DRAWING IS THE SOLE PROPERTY OF FIGMENTS EXPERIENCE LAB AND IS NOT TO BE COPIED OR USED WITHOUT PRIOR PERMISSION. - ALL DIMENSIONS IN THE DRAWING ARE TO BE READ AND NOT TO BE MEASURED. - ALL DIMENSIONS SHALL BE CORRELATED WITH STRUCTURAL AND SERVICE DRAWINGS AND ANY AMBIGUITY SHALL BE IMMEDIATELY BROUGHT TO THE NOTICE OF THE DESIGN TEAM BEFORE THE COMMENCEMENT OF WORK. - THIS DRAWING SHALL SUPERSEDE ITS PREVIOUS REVISIONS.	CLIENT: THEOBROMA FOODS PVT. LTD. DESIGNERS: FIGMENTS EXPERIENCE LAB 306, T1 Building, Sakinaka, PUNE, 411 004, PUNJAB 02045_202403020022	CONSTRUCTION COMPANY STRUCTURAL CONSULTANT PROJECT MANAGEMENT SERVICES CONSULTANT (S) SERVICES CONSULTANT (S) SERVICES CONSULTANT (S) SERVICES CONSULTANT (S)	PROJECT: THEOBROMA MUMBAI PUNE EXPRESSWAY	TITLE: HVAC LAYOUT	PROJ. NO. -	DATE 12-08-2024
					UNITS MILLIMETERS	REVISION NO. R1
					CHECKED -	NORTH -
					DEALT -	DRG. NO. H-301
					APPROVED -	